



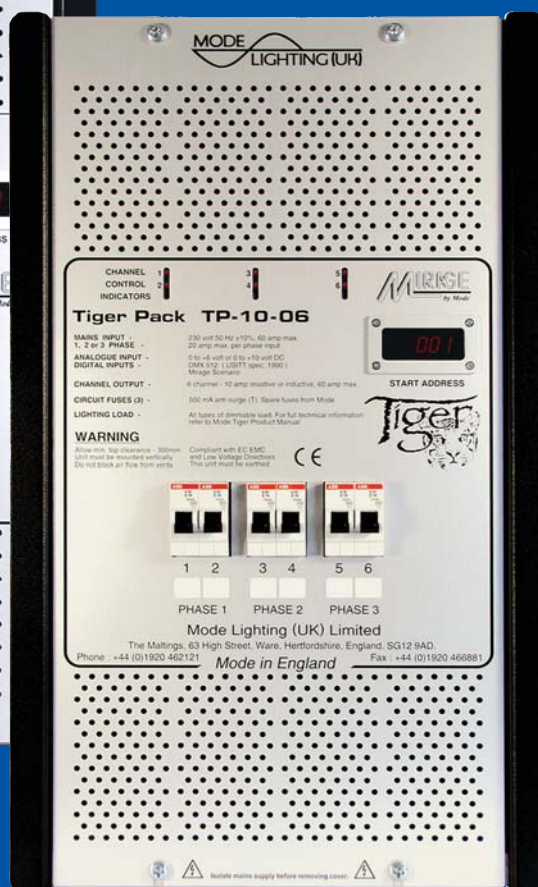

Mode Tiger Dimmable Power Unit

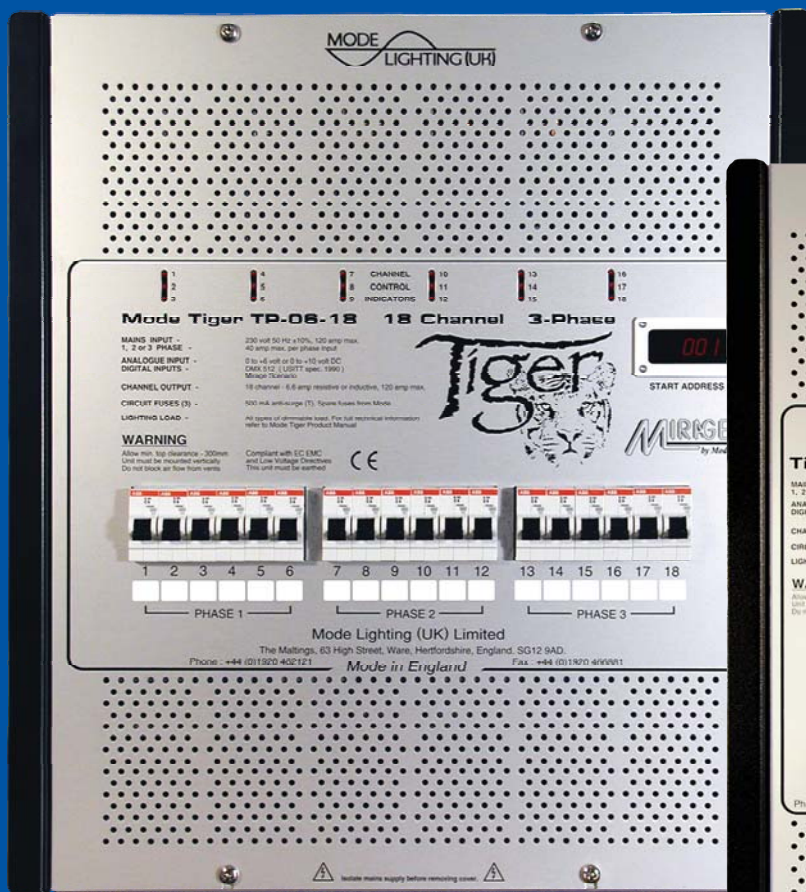

MODE LIGHTING (UK) LIMITED

The Maltings, 63 High Street, Ware, Hertfordshire, SG12 9AD, England.

Tel: +44 (0) 1920 462121 e-mail: sales@modelight.com Fax: +44 (0) 1920 466881



TIGER INSTALLATION MANUAL

TP-10-06 and TP-06-09

Page

1. Contents
2. Introduction
3. Installation procedure
4. Mechanical fixing
5. Identification of terminals TP-10-06 (6 channel)
6. Identification of terminals TP-06-09 (9 channel)
7. Mains supply wiring
8. Output wiring TP-10-06 (6 channel)
9. Output wiring TP-06-09 (9 channel)
10. Control wiring - low voltage
11. Control module settings
12. Power module functions
13. Indicator identification
14. Technical specification TP-10-06 (6 channel)
15. Technical specification TP-06-09 (9 channel)
16. Spares and Maintenance
17. Circuit/Load schedule

Mode Lighting (UK) Limited.

The Maltings, 63 High Street, Ware, Herts, England. SG12 9AD.

Tel : +44 (0)1920 462121 Fax : +44 (0)1920 466881

e-mail: sales@modlighting.com



"Reliability from Mode"

MODE POLICY: To create superior products and to provide our customers with long term reliability, serviceability and value for money. The Company does not make economies which are of short term benefit only.

FOUNDATION: Mode was established in 1970 as an Original Equipment Manufacturer in Hertfordshire, England. Mode designs and manufactures in the U.K. Architectural Lighting Control Equipment, Electronic Transformers, Cold Cathode (Neon) Convertors and many other Electronic Lighting products. Mode is a subsidiary of a privately owned Holding Company known as TCL and has four associated electronic companies who together trade as "The Mode Group".

PREMISES: The Mode Group occupies well equipped factories, offices and large warehouses in Ware and Hertford, having a commercial area of 10,000m². We are situated 40Km from London, 50Km from Heathrow Airport and 20Km from Stansted Airport.

STAFF: The Mode Group employs more than 140 persons, including thirty Managers, twenty Engineers and Technicians and over eighty Manufacturing Staff. There are three Principal Directors and seven other Directors who between them own all of the issued share capital of the Holding Company.

CLIENTS: The Mode Group has over 500 clients in over 30 countries.

Mode Lighting (UK) Limited.

The Maltings, 63 High Street, Ware, Herts, England. SG12 9AD.

Tel : +44 (0)1920 462121 Fax : +44 (0)1920 466881

e-mail: sales@modelighting.com

INSTALLATION PROCEDURE



1. Remove all packaging.
2. Read instructions and retain for future reference.
3. Fit unit to wall and observe spacing instructions.
4. Remove front plate and store in a safe place.
5. Fit trunking (4" minimum) to desired option.
6. Install all input supply wiring to National Wiring Regulations and other applicable Regulations.
7. Install all output load wiring to National Wiring Regulations and other applicable Regulations.
8. Install all low voltage control wiring.
9. Set all switches and jumper links.
10. Ensure that all wiring is tidy and that all ventilation grilles are unobstructed.
11. Switch on supply to unit.
12. Test all loads are operating correctly.
13. Set "start" address.
14. Program operating system.
15. Test operation.
16. Re-fit front plate.

Mode Lighting (UK) Limited.

The Maltings, 63 High Street, Ware, Herts, England. SG12 9AD.

Tel : +44 (0)1920 462121 Fax : +44 (0)1920 466881

e-mail: sales@modelighting.com


MECHANICAL FIXING



Mark positions, drill holes and fit screws to wall, see diagram below.


Dimensions in millimetres.

Hang unit on screws and tighten.

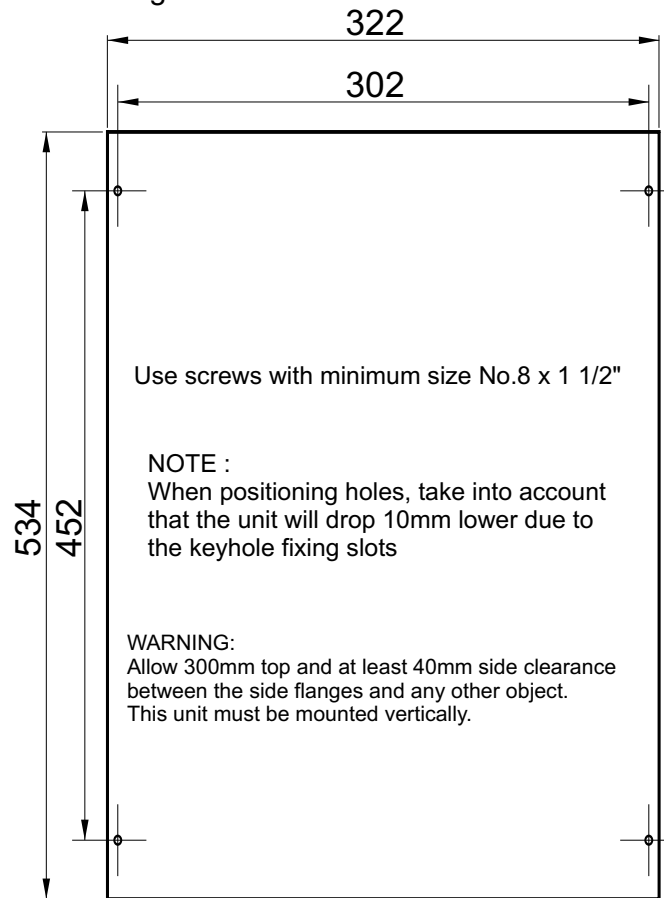


TRUNKING OPTIONS

Connect unit to trunking (4" trunking min.) using up to five 32mm couplers. These are pitched 48mm apart and centred 62mm from the wall. See diagram below.


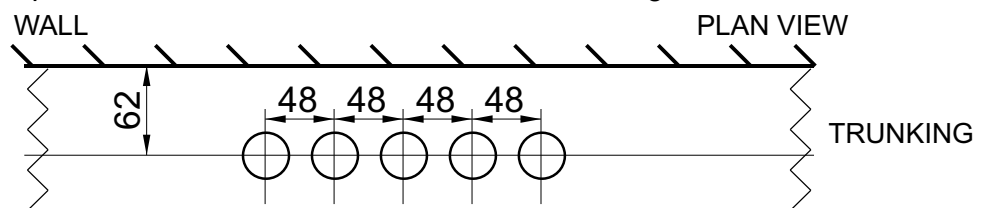


OR


Cut notch in trunking 250mm wide as shown in the diagram below. Remove the knockout plate from the Tiger Power Unit underside and fit trunking to wall, butting up underneath the Power Unit. Ensure all sharp edges are covered to prevent damage to cable insulation.

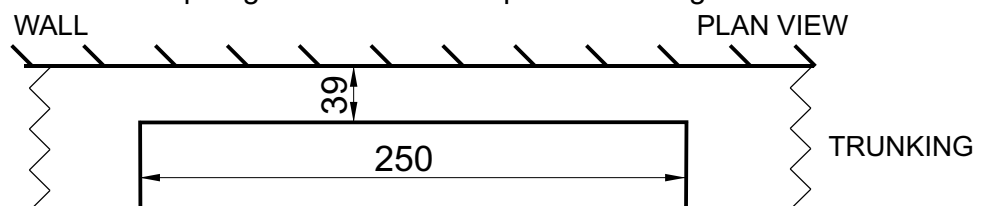


IDENTIFICATION OF TERMINALS TP-10-06 (6 CHANNEL)

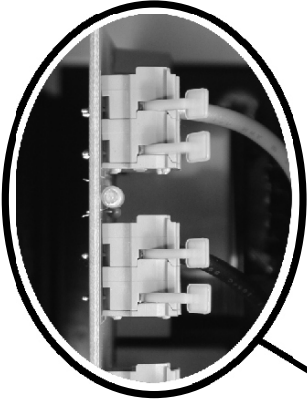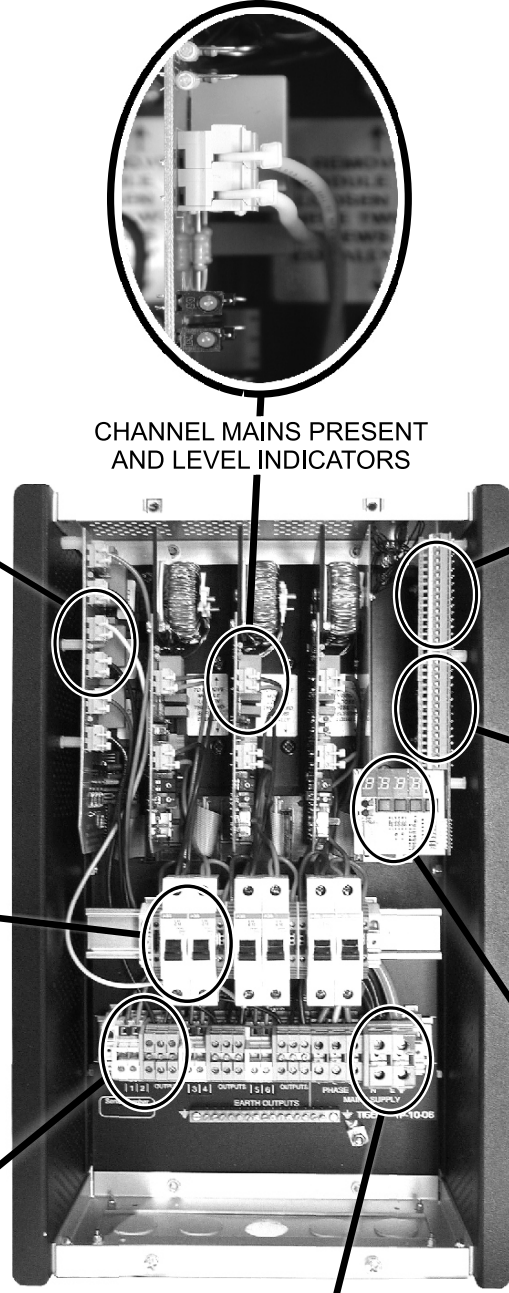


PHASE INPUT NEONS

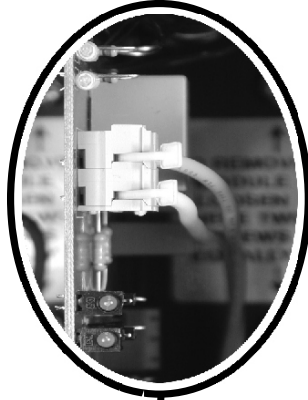


CHANNEL MAINS PRESENT AND LEVEL INDICATORS

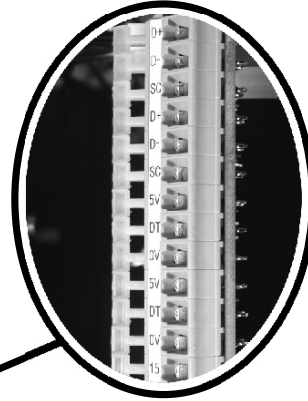


DMX / SCENARIO INPUT TERMINALS

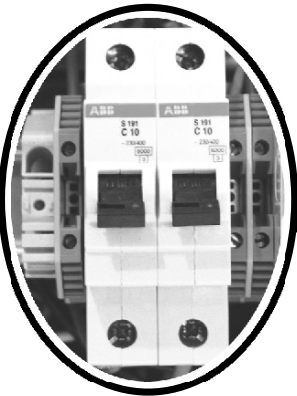


EMERGENCY TERMINALS AND MCBs

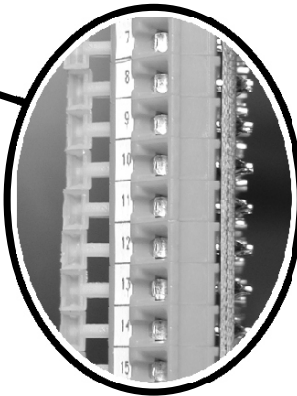


ANALOGUE INPUT / OUTPUT TERMINALS

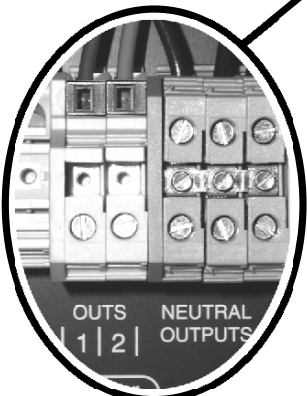

CHANNEL OUTPUT TERMINALS

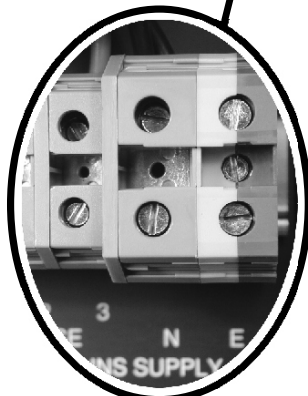


MAINS INPUT TERMINALS

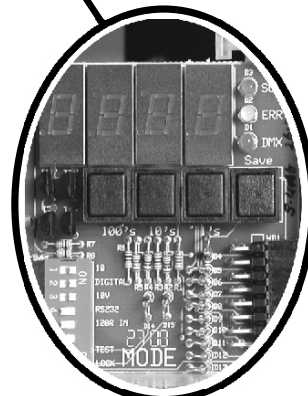


START ADDRESS AND FUNCTION SWITCHES


IDENTIFICATION OF TERMINALS TP-06-09 (9 CHANNEL)

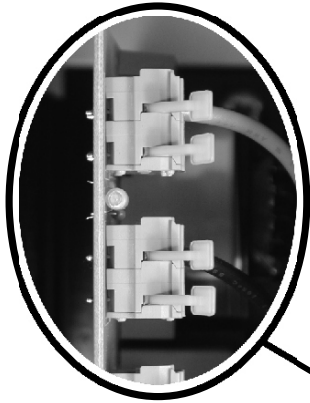


PHASE INPUT NEONS

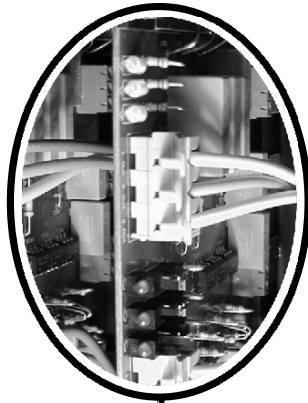



CHANNEL MAINS PRESENT AND LEVEL INDICATORS

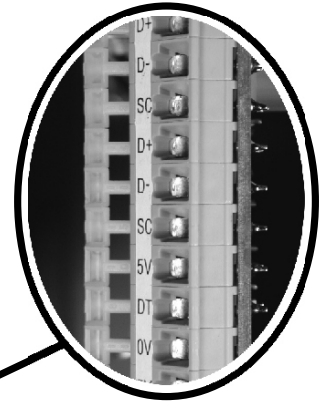


DMX / SCENARIO INPUT TERMINALS

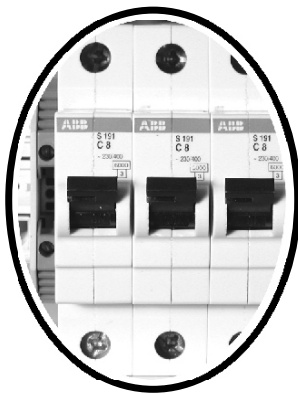


EMERGENCY TERMINALS AND MCBIS

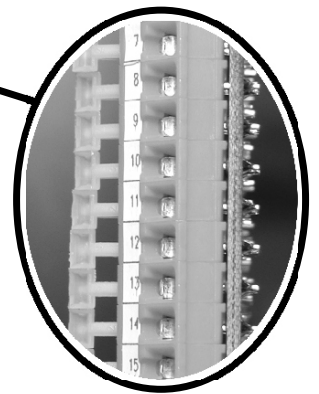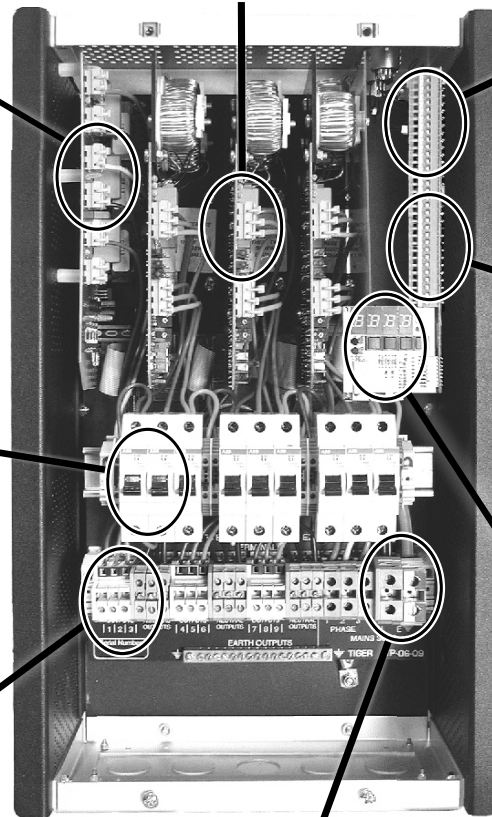


ANALOGUE INPUT / OUTPUT TERMINALS

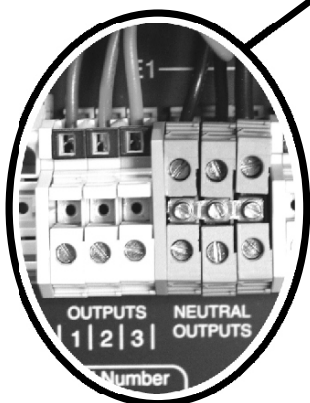

CHANNEL OUTPUT TERMINALS

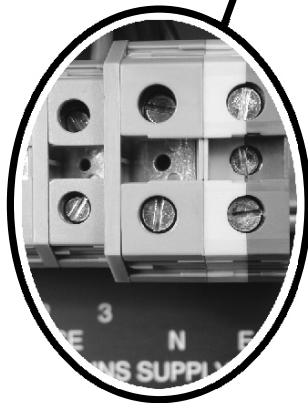

MAINS INPUT TERMINALS

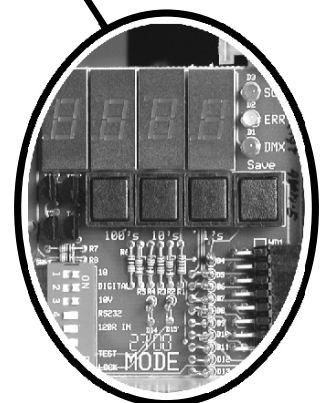


START ADDRESS AND FUNCTION SWITCHES

MAINS SUPPLY WIRING



This unit is to be wired by a suitably qualified electrician in accordance with National Wiring Regulations and other applicable Regulations.

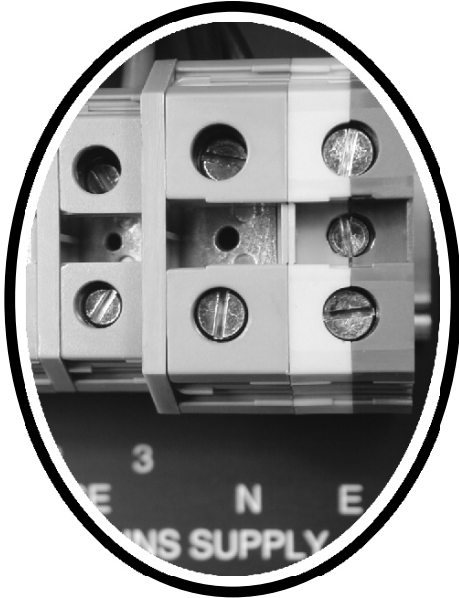

TERMINALS

Three Live phase input terminals (20 amp max.).

One Neutral input terminal (60 amp max.).

One Earth input terminal (60 amp max.).

TERMINAL SPECIFICATIONS

Terminal	Wire sizes mm ²		Strip length mm	Tightening torque	
	Stranded	Solid		Nm	lb/in
Phase 1	4 - 16	4 - 25	14	1.2 - 1.4	10.6 - 12.3
Phase 2	4 - 16	4 - 25	14	1.2 - 1.4	10.6 - 12.3
Phase 3	4 - 16	4 - 25	14	1.2 - 1.4	10.6 - 12.3
Neutral	10 - 35	10 - 50	17	2.8 - 3.0	21.8 - 26.1
Earth	10 - 35	10 - 50	17	2.8 - 3.0	21.8 - 26.1

CONNECTION

Connect three live input feeds using wire of between the values stated above and in accordance with the calculated loadings. The live feeds do not have to be from different phases. Any combination of phases is acceptable.


Connect Neutral feed using wire of between the values stated above and in accordance with the calculated loadings.

Connect Earth using wire of between the values stated above and in accordance with the calculated loadings.

OUTPUT WIRING TP-10-06 (6 CHANNEL)



This unit is to be wired by a suitably qualified electrician in accordance with National Wiring Regulations and other applicable Regulations.

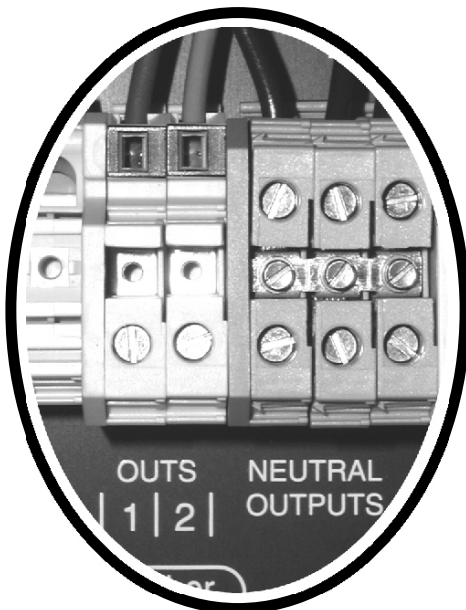

CHANNEL OUTPUT TERMINALS

- 6 Live output terminals (10 amp max.).
- 6 Neutral output terminals (10 amp max.).
- One 15 way Earth common bars (10 amp max.).

CONNECTION

Connect loads using wire of between the values stated below and in accordance with the calculated loadings. Live, Neutral and Earth wires of the same channel must pass out through the same coupler.

TERMINAL SPECIFICATIONS

Terminal	Wire sizes mm ²		Strip length mm	Tightening torque	
	Stranded	Solid		Nm	lb/in
Live outputs	1 - 6	1 - 10	12	0.8 - 1.0	7.1 - 8.9
Neutral outputs	1 - 6	1 - 10	12	0.8 - 1.0	7.1 - 8.9
Earth outputs	1 - 6	1 - 10	12	0.8 - 1.0	7.1 - 8.9
Emergency outs	1 - 2.5	1 - 2.5	10	0.5 - 0.7	4.4 - 6.2


EMERGENCY OUTPUT TERMINALS

Live monitor output terminals for all channels are located adjacent to the channel MCB's.

These terminals provide a live monitor for emergency light fittings. If the channel MCB trips the emergency fittings switch over to battery operation.

CONNECTION


Connect emergency fittings using wire between the values stated above and in accordance with the calculated loadings. Live, Neutral and Earth wires of the same channel must pass out through the same coupler. NOTE : The emergency current and channel load current added together should not exceed the maximum channel current.

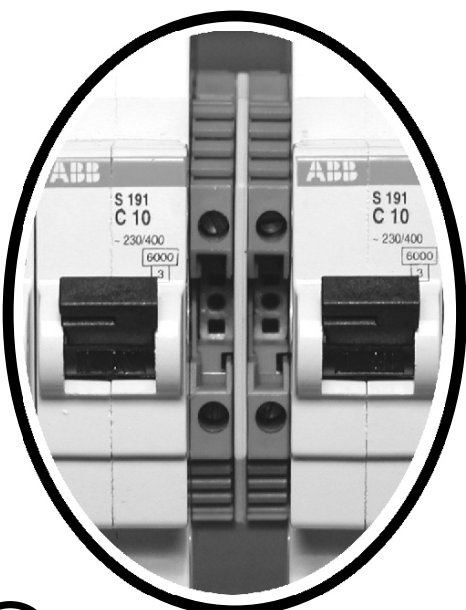

OUTPUT WIRING TP-06-09 (9 CHANNEL)



This unit is to be wired by a suitably qualified electrician in accordance with National Wiring Regulations and other applicable Regulations.

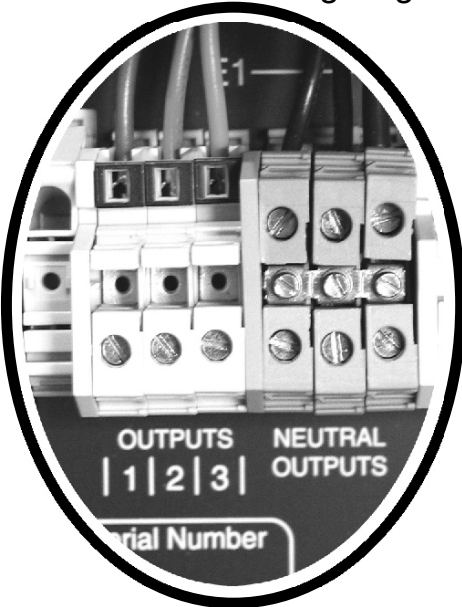

CHANNEL OUTPUT TERMINALS

- 9 Live output terminals (6.6 amp max.).
- 9 Neutral output terminals (6.6 amp max.).
- One 15 way Earth common bars (6.6 amp max.).

CONNECTION

Connect loads using wire of between the values stated below and in accordance with the calculated loadings. Live, Neutral and Earth wires of the same channel must pass out through the same coupler.

TERMINAL SPECIFICATIONS

Terminal	Wire sizes mm ²		Strip length mm	Tightening torque	
	Stranded	Solid		Nm	lb/in
Live outputs	1 - 6	1 - 10	12	0.8 - 1.0	7.1 - 8.9
Neutral outputs	1 - 6	1 - 10	12	0.8 - 1.0	7.1 - 8.9
Earth outputs	1 - 6	1 - 10	12	0.8 - 1.0	7.1 - 8.9
Emergency outs	1 - 2.5	1 - 2.5	10	0.5 - 0.7	4.4 - 6.2


EMERGENCY OUTPUT TERMINALS

6 Live monitor output terminals for channels 1,3,4,6,7 and 9 located adjacent to the channel MCB's.

These terminals provide a live monitor for emergency light fittings. If the channel MCB trips the emergency fittings switch over to battery operation.

CONNECTION


Connect emergency fittings using wire between the values stated above and in accordance with the calculated loadings. Live, Neutral and Earth wires of the same channel must pass out through the same coupler. NOTE : The emergency current and channel load current added together should not exceed the maximum channel current.

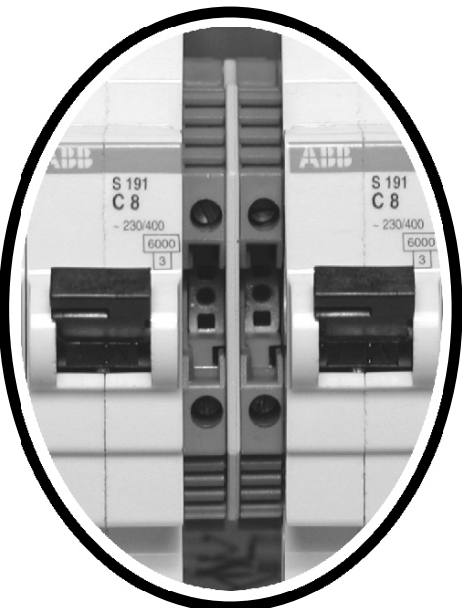


CONTROL WIRING (LOW VOLTAGE)




EXTERNAL CONNECTORS (top plate)



RS-232 9 way D connector - for future use.



5 Pin XLR chassis socket for DMX connection.
Connections:- DMX⁺ = pin 3, DMX⁻ = pin 2, Screen = pin 1.




5 Pin XLR chassis plug for DMX connection.
Connections:- DMX⁺ = pin 3, DMX⁻ = pin 2, Screen = pin 1.



25mm conduit entry for hard wired control cables.

DATA INPUT TERMINALS (for digital control only)

Lever operated screwless terminals as follows:-

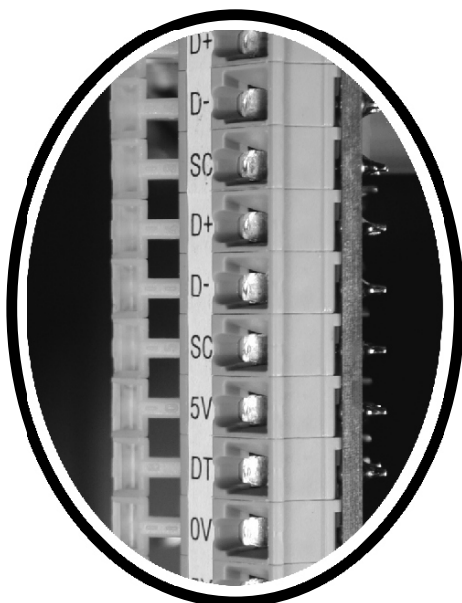

- | | | |
|------------------------------------|---|---------|
| D+ = DMX+ | } | Inputs |
| D- = DMX- | | |
| SC = DMX Screen | | |
| D+ = DMX+ | } | Outputs |
| D- = DMX- | | |
| SC = DMX Screen | | |
| 5 V = +5V supply to Scenario plate | } | Inputs |
| DT = Scenario Data line | | |
| 0 V = 0V reference | | |
| 5 V = +5V supply to Scenario plate | } | Outputs |
| DT = Scenario Data line | | |
| 0 V = 0V reference | | |

AUXILIARY TERMINALS

- 15 = +15V DC output to supply remote equipment
- AL = Alarm input


TERMINALS 1 - 18

In Digital Mode


These terminals provide either 0 to +6V or 0 to +10V DC control signals.
Capable of sourcing 50µA and sinking 100mA.
For 6 channel type terminals 07-18 are not used.
For 9 channel type terminals 10-18 are not used.

In Analogue Mode

Terminals 1-9 to be supplied with a DC control signal of 0 to +6V or 0 to +10V.
For 6 channel type terminals 07-18 are not used.

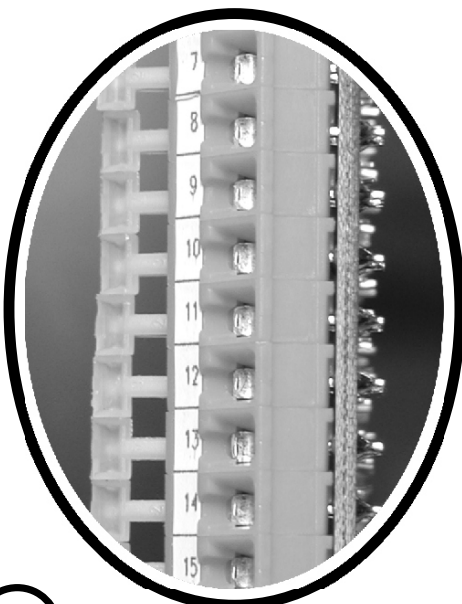

CONTROL MODULE SETTINGS

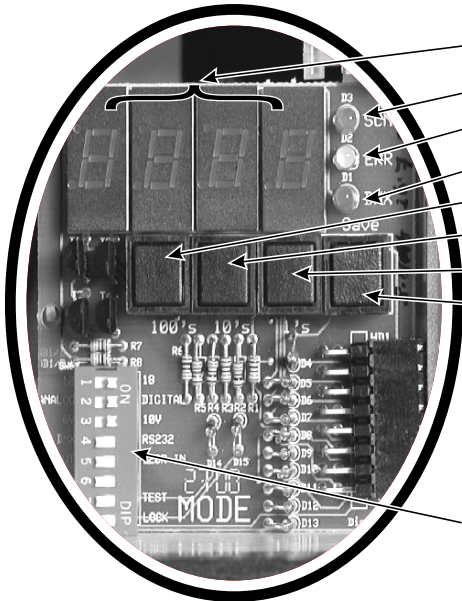

- Display showing start address.
- Scenario data indicator.
- Data error indicator.
- DMX data received indicator.
- Push button increment 100's for start address.
- Push button increment 10's for start address.
- Push button increment 1's for start address.
- For future use.
- DIP switches - RIGHT=ON.
 - 1 - 6 / 9 channels (6 = off).
 - 2 - Digital / Analogue (Analogue = off).
 - 3 - 6V / 10V Operation (6V = off).
 - 4 - DMX / RS232 (DMX = off).
 - 5 - Set DMX terminator, not used in Scenario systems.
 - 6 - Tiger 120/60 (120 = off).
 - 7 - Normal / Test (Normal = Off).
 - 8 - Unlock / Lock (Unlock = Off).

NOTE - For Scenario operation switch 4 should be set to DMX. The processor will sense that DMX is not present and will operate in Scenario mode. If a DMX signal is detected it will override the Scenario data bus. The terminator switch should always be set to off for Scenario installations.

Switch setting examples - the first two examples are the factory settings.

	<p>← 9 channel, Digital, 10V, DMX or Scenario, Not last in DMX line. When in digital mode the 10V refers to the output voltage available for driving ballasts etc..</p>
	<p>← 6 channel, Digital, 10V, DMX or Scenario, Not last in DMX line.</p>
	<p>← 9 channel, Analogue, 10V, DMX or Scenario, Not last in DMX line. When in analogue mode the position of switch 4 is ignored. The 10V refers to a voltage of 0-10V required to drive the channel between off and full on.</p>
	<p>← 6 channel, Analogue, 6V, DMX or Scenario, Not last in DMX line.</p>
	<p>← 6 channel, Digital, 10V, RS232, Last in DMX line.</p>
	<p>← 9 channel, Digital, 10V, RS232, Last in DMX line.</p>

Maximum number of channels for DMX operation is 512.
 Maximum number of channels for Scenario operation is 99.
 In the event of a DMX or Scenario error the last level received will be maintained.

Refer to Mirage Scenario programming guide for functions associated with the architectural scene setting system.

POWER MODULE FUNCTIONS



TWIN MODULE
used in 6 channel model TP-10-06

Heatsink and mounting bracket

RFI noise suppression chokes

Channel mains feed indicators 2 (green)

User replaceable triac

Channel control signal indicators 2 (red)


Output pre heat adjustment control

Set switch point for switching channels

Set alarm enable for selected channel

Set a channel to switch or dim

Module full on test switch

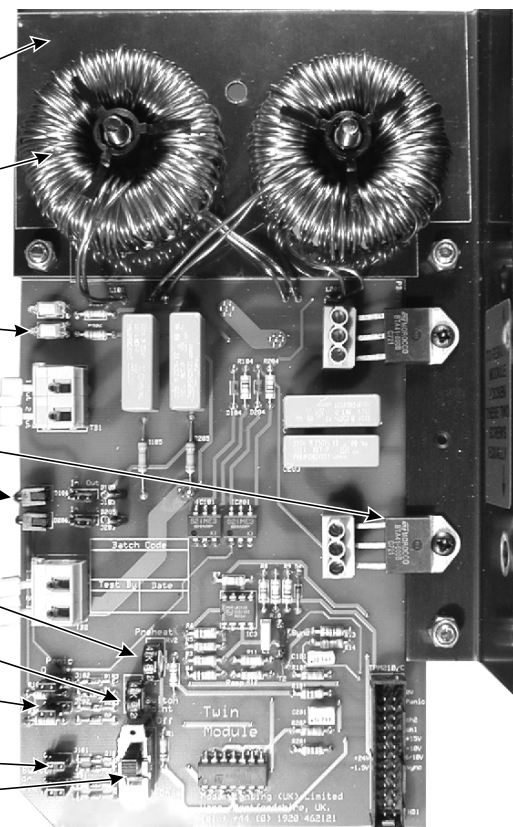

TRIPLE MODULE
used in 9 channel model TP-06-09

Heatsink and mounting bracket

RFI noise suppression chokes

Channel mains feed indicators (green)

User replaceable triac

Channel control signal indicators (red)


Output pre heat adjustment control

Set switch point for switching channels


Set alarm enable for selected channel

Set a channel to switch or dim

Module full on test switch

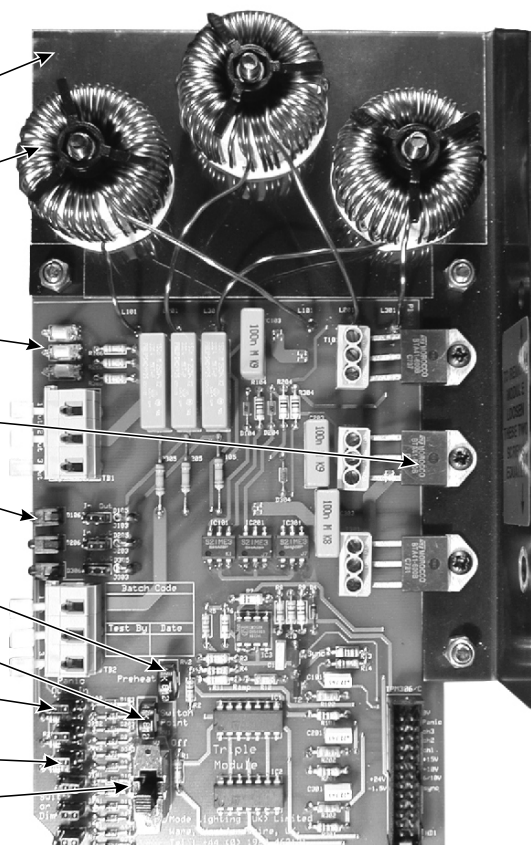

INDICATOR IDENTIFICATION

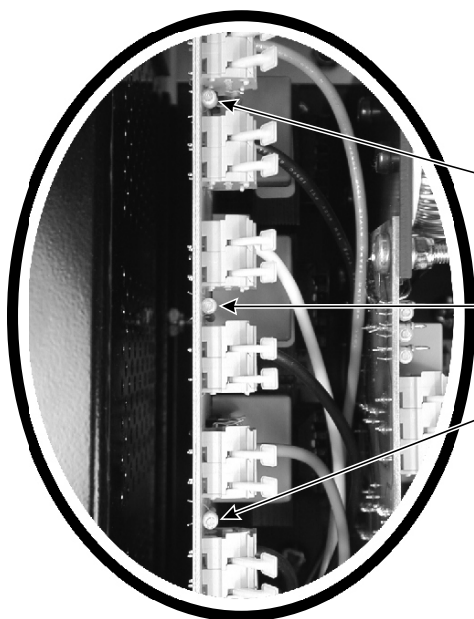


The three neons shown indicate when the phase input is live.

Phase 1

Phase 2


Phase 3

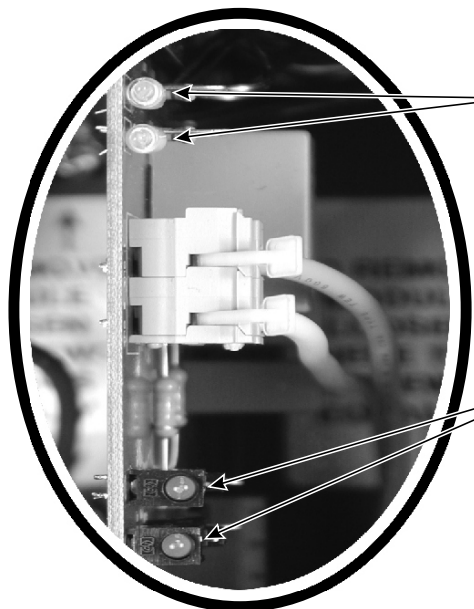

TP-10-06 (6 channel)

The two green neons shown indicate when the channel input is live i.e. when the MCB is on.

The two red LED's indicate a control signal is present. These still operate if the mains to the module is not switched on.

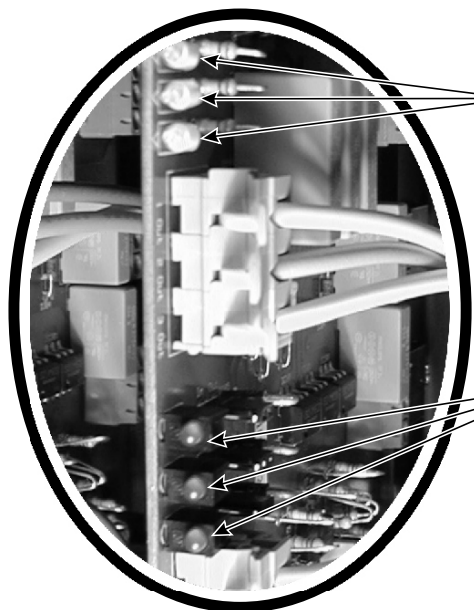

TP-06-09 (9 channel)

The three green neons shown indicate when the channel input is live i.e. when the MCB is on.

The three red LED's indicate a control signal is present. These still operate if the mains to the module is not switched on.

TECHNICAL SPECIFICATION TP-10-06 (6 CHANNEL)



POWER SUPPLY

Voltage 230V AC nominal. (207V - 253V), 50Hz.
(110V 60Hz AC nominal available to order)
Single phase neutral and earth - three 20 amp live feeds.
Three phase neutral and earth Star configuration - 20 amp/phase.
(Three phase Delta configuration available to order)
Connection - hard wired to din rail mounting screw terminals.
TOTAL CURRENT 60 AMP.

DIMMING OUTPUTS

Hard fired leading edge triac triggering.
Maximum load 10 amps per channel resistive, 9 amps inductive.
Minimum load 40 watts per channel (200 watts for fluorescent - ballasts, when channel set to switch output).
Output connections hard wired :-
Live and Neutral outputs - din rail mounting screw terminals.
Earth outputs - brass earth common bar.

EMERGENCY OUTPUTS

Six switched live outputs on channels 1,2,3,4,5, and 6.
These outputs will normally give full mains output and under fault conditions which trip the channel circuit breaker give zero output.
The total current on these channels emergency + dimmed must not exceed the maximum channel rating.

PROTECTION

Individual 10 amp Type C channel feed circuit breakers.
Green channel feed live indicators.
PSU module phase fuses 500mA anti-surge (3).

CONTROL INPUTS

0-6V or 0-10V analogue, hard wired to screwless terminals.
Mirage Scenario data bus, hard wired to screwless terminals.
USITT DMX512 (1990), hard wired or via 5 pin XLR.
RS-232 interface via 9 pin D connector.
Alarm input - will set all alarm enabled channels to full output.
Control options set by DIP switches.

DC OUTPUTS

+5V at 50mA and +15V at 50mA hard wired to screwless terminals.

DIMENSIONS

	<u>Packed</u>	<u>Unpacked</u>
Height	600mm	534mm
Width	400mm	322mm
Depth	240mm	160mm
Weight	11.3kgs	9.5kgs

FIXING CENTRES

Vertical = 452mm Horizontal = 302mm



WARNING - Allow 300mm top and at least 40mm side clearance
Between the side flanges and any other object.
This unit must be mounted vertically.

ENVIRONMENT

Operating temperature 0°C to +40°C.
Maximum case temperature +90°C.

TECHNICAL SPECIFICATION TP-06-09 (9 CHANNEL)



POWER SUPPLY Voltage 230V AC nominal. (207V - 253V), 50Hz.
(110V 60Hz AC nominal available to order)
Single phase neutral and earth - three 20 amp live feeds.
Three phase neutral and earth Star configuration - 20 amp/phase.
(Three phase Delta configuration available to order)
Connection - hard wired to din rail mounting screw terminals.
TOTAL CURRENT 60 AMP.

DIMMING OUTPUTS Hard fired leading edge triac triggering.
Maximum load 6.6 amps per channel resistive, 6 amps inductive.
Minimum load 40 watts per channel (200 watts for fluorescent ballasts, when channel set to switch output).
Output connections hard wired :-
Live and Neutral outputs - din rail mounting screw terminals.
Earth outputs - brass earth common bars.

EMERGENCY OUTPUTS Six switched live outputs on channels 1,3,4,6,7 and 9.
These outputs will normally give full mains output and under fault conditions which trip the channel circuit breaker give zero output.
The total current on these channels emergency + dimmed must not exceed the maximum channel rating.

PROTECTION Individual 8 amp Type C channel feed circuit breakers.
Green channel feed live indicators.
PSU module phase fuses 500mA anti-surge (3).

CONTROL INPUTS 0-6V or 0-10V analogue, hard wired to screwless terminals.
Mirage Scenario data bus, hard wired to screwless terminals.
USITT DMX512 (1990), hard wired or via 5 pin XLR.
RS-232 interface via 9 pin D connector.
Alarm input - will set all alarm enabled channels to full output.
Control options set by DIP switches.

DC OUTPUTS +5V at 50mA and +15V at 50mA hard wired to screwless terminals.

DIMENSIONS	<u>Packed</u>	<u>Unpacked</u>
Height	600mm	534mm
Width	400mm	322mm
Depth	240mm	160mm
Weight	12.3kgs	10.5kgs

FIXING CENTRES Vertical = 452mm Horizontal = 302mm



WARNING - Allow 300mm top and at least 40mm side clearance
Between the side flanges and any other object.
This unit must be mounted vertically.

ENVIRONMENT Operating temperature 0°C to +40°C.
Maximum case temperature +90°C.

STANDARDS Complies with CE EMC and LVD requirements.

MAINTENANCE



Periodically inspect the wiring for damage.

Ensure the ventilation holes have not become covered or blocked with dust.

Check overall condition of unit.

SPARES

The following spare parts are available:-

Item	Reference
PSU Module	TP-120-PSU
Twin Module	TPM-210
Triple Module	TPM-306
Digital Module	TP-120-DCM

ASSOCIATED PRODUCTS

TP-10-12 Tiger Dimmable Power Unit 12 x 10A

TP-06-18 Tiger Dimmable Power Unit 18 x 6A

MS-00-12 Scenario Master Switch Plate

RS-00-06 Scenario Remote Switch Plate

RT-00-10 Scenario Remote 7-day Time Clock

Remote Dimmer Outstations - Rotary or Slider Control

Dimmable Electronic Transformers for low voltage Tungsten Halogen Lighting.

Dimmable Neon Convertors for Cold Cathode (Neon) Lighting.

For further information, please contact:-

Mode Lighting (UK) Limited.

The Maltings, 63 High Street, Ware, Herts, England. SG12 9AD.

Tel : +44 (0)1920 462121 Fax : +44 (0)1920 466881

e-mail: sales@modelighting.com

Mode Lighting (UK) Limited was established in 1970 as a manufacturer of electronic components for the lighting industry. Mode has an enviable reputation for quality, reliability and customer service. The Mode Group employs more than 140 people in over 10,000m² of well equipped factories, offices and warehouses.

Products include:-


Electronic Transformers for Low Voltage.

Electronic Cold Cathode Convertors.

Architectural Dimming Systems.

Electronic Ballasts.

LED Systems.

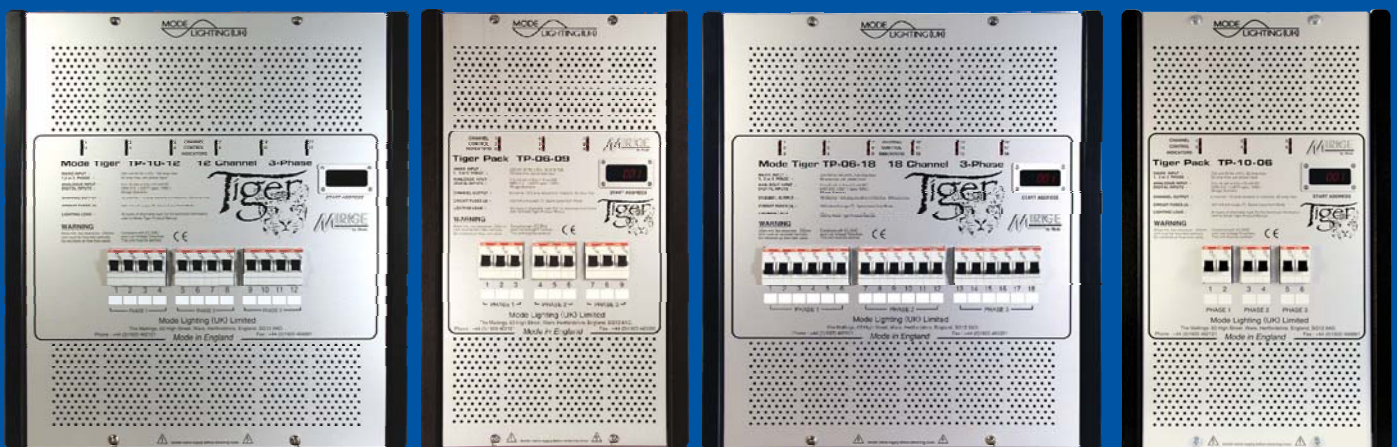

TP-10-12

TP-06-09

TP-06-18

TP-10-06

“Controlling the Future of Lighting”